

VASTAVUSDEKLARATSIOON

Toote nimetus: ONNLINE kuulkraanid messing ning erimessing (tsingikaakindel) mõõtudega : ¼"-4"

Tootja nimi ja aadress: Zhejiang IDC Fluid Controls Co. Ltd.
Zhugang Town, Yuhuan County, Zhejiang, P.R Hiina

Deklaratsiooni esitaja: Onninen AS (Betooni 6, 11415 Tallinn), kes on tootja volitatud esindaja Eestis.

Toote kasutusala: Sobib tarbevee (k.a. joogivee)-, jahutuse-, kütte- ja vee tehnosüsteemidesse.

Vastavus nõuetele: Tooted on sertifitseeritud standardile EN 12266-1:2012 seoses Euroopa Direktiiviga 97/23/EC Annex III Module H nõuetega.

Alusdokumendid: Tootja sertifikaat nr. EC.1282.OP140908.IDCTQ96

Deklaratsiooni väljaandja esindaja:



Kuuno Kirspuu
Juhatuse liige

Välja antud: 26.5.2017 Tallinnas

AS Onninen
Betooni 6
11415 Tallinn
Telefon 6105 500
Faks 6105 515
Nordea pank 17000270098
Ärregistri reg nr 10180761

onninen

Verification of Compliance



No. EC.1282.0P140908.IDCTQ96

Certificate's Holder: IDC Plumbing & Heating Technology (Beijing) Ltd.
3rd Floor, Unit 2, Building 2, Section A, Zhaowei Science & Technology Park, No.14, Jiuxianqiao Road, Chaoyang District, Beijing, China

Manufacturer: Zhejiang IDC Fluid Controls Co. Ltd.
Machinery Industrial Park, Zhugang Town, Yuhuan County, Zhejiang, P.R. China

Product: Valves
Model(s): DN8~DN100
PN10~PN40
-20°C~180°C

Technical Data: (see the following Annex I)

Verification to Standard:
EN 12266-1:2012

related to:
Directive 97/23/EC (Pressure Equipment)
CATEGORY III, MODULE H

Remark: This Verification of Compliance has been issued on a voluntary basis. ECM confirms that a Technical Construction File (TCF) is existent for the above listed product(s).

The TCF satisfactorily covers the essential requirements of the above listed standards related to **Directive 97/23/EC (Pressure Equipment)**.

Other relevant Directives have to be observed in case they are applicable.


This Document is only valid for the equipment and configuration described and in conjunction with the TCF detailed above. Whereas the Manufacturer is responsible of the certification of the product(s) and not exempted to perform all the necessary activities before placing the product(s) on the market.

The Manufacturer is also responsible of the internal production control to ensure the product(s) are in compliance with the essential requirements of the above mentioned Directive(s).

This certificate can be checked for validity at www.entecerma.org

Date of issue SEPTEMBER 2014

Certification Chief Manager
Tim Mahan



Expiry date SEPTEMBER 2019

Certification Deputy Manager
Viola Miller



Ente Certificazione Macchine Srl


Via Cavour 243 – Loc. Castello di Serravalle – 40053 Valsamoggia (BO) - ITALY
☎ +39 051 6705141 ☎ +39 051 6705156 ✉ info@entecerma.it 🌐 www.entecerma.it

Annex I

No. EC.1282.0P140908.IDCTQ96



PRODUCT	DN	PRESSURE (BAR)	TEMPERATURE °C
Ball Valve	8~100	40	-20 to + 120
Isolation Valve	15~54	16	0 to + 85
Check Valve	8~100	25	-10 to + 180
Y Strainer	8~50	25	-20 to + 120
Globe Valve	15~100	16	-20 to + 120
Gate Valve	15~100	20	-10 to + 180

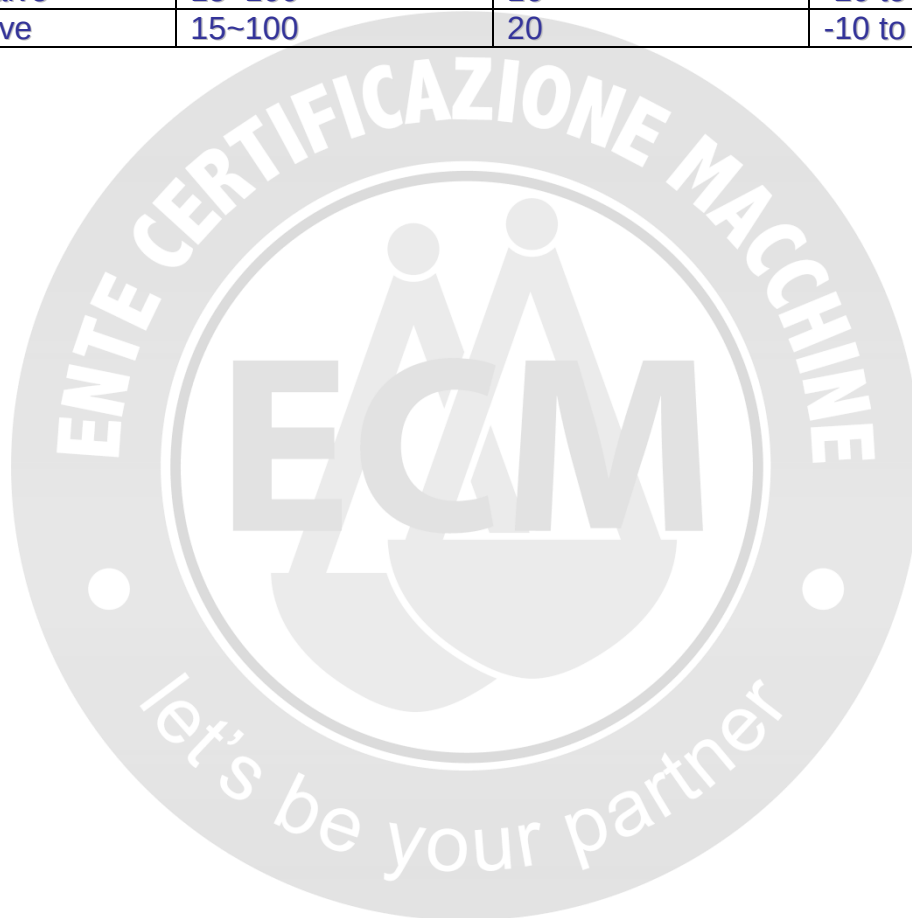

Ente Certificazione Macchine Srl

Via Ca' Bella, 243 – Loc. Castello di Serravalle – 40053 Valsamoggia (BO) - ITALY
 ☎ +39 051 6705141 📠 +39 051 6705156 ✉ info@entecerma.it 🌐 www.entecerma.it